




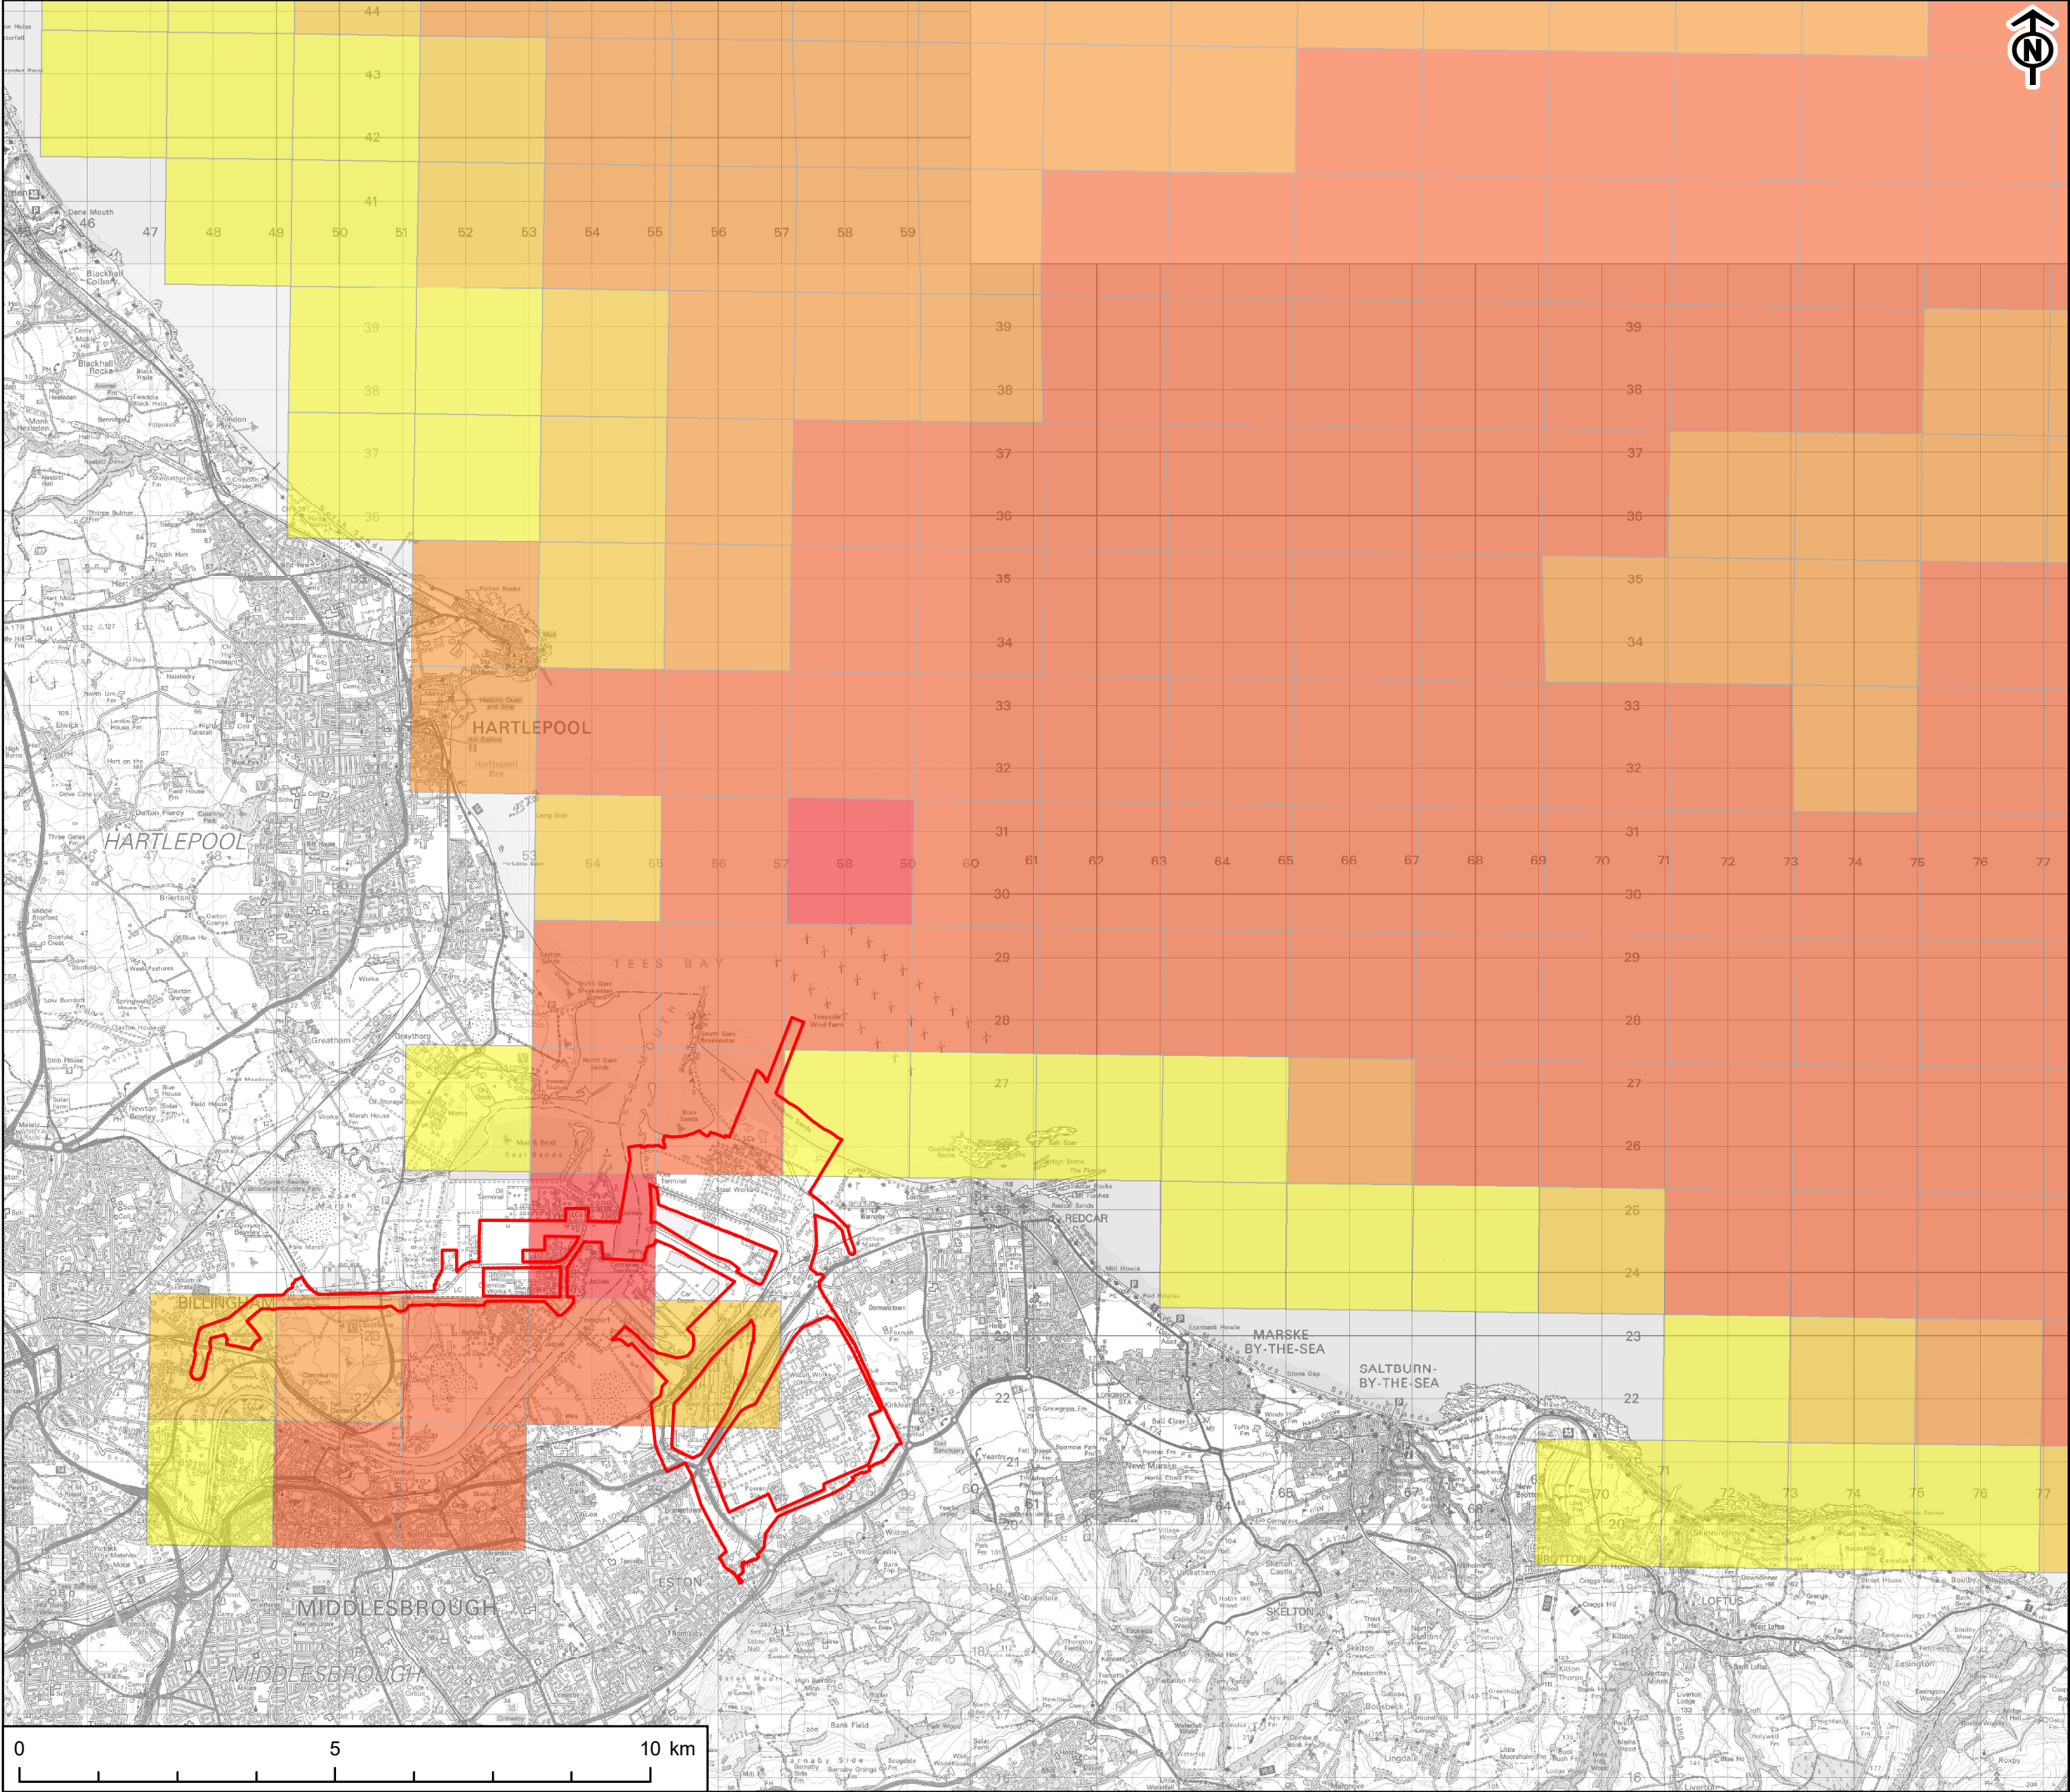

PROJECT

NET ZERO TEESSIDE

CLIENT

NZT POWER AND NZNS STORAGE

KEY

 Site Boundary

Vessel Density Grid 2015 (MMO)

Total Vessels - Annual Average

 > 0 - 200

 > 200 - 500

 > 500 - 1,000

 > 1,000 - 10,000

 > 10,000

TITLE

FIGURE 20-7
VESSEL DENSITY GRID

REFERENCE

NZT_200618_PEI_S_20-7_v3

SHEET NUMBER

1 of 1

DATE

18/06/2020

This drawing has been produced for the use of AECOM's client. It may not be used, modified or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies upon this drawing without AECOM's express written consent. All dimensions are indicative and in metres unless otherwise noted. Do not scale this document.